


NORLYS ASKER BIG 1303


AC 220-240V 50-60Hz | IP 65 | IK 08 | E27

Asker big
1303XX0010
16.09.2026 v.10.9
www.norlys.no

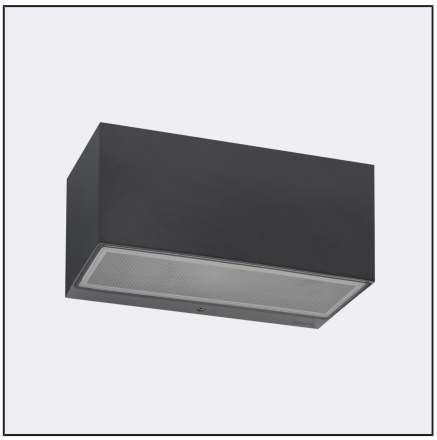

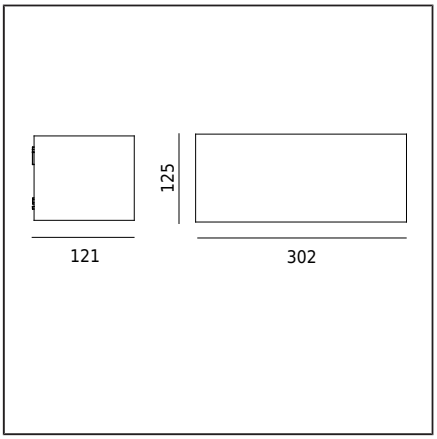

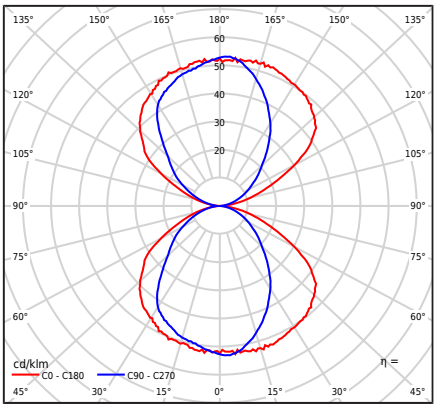

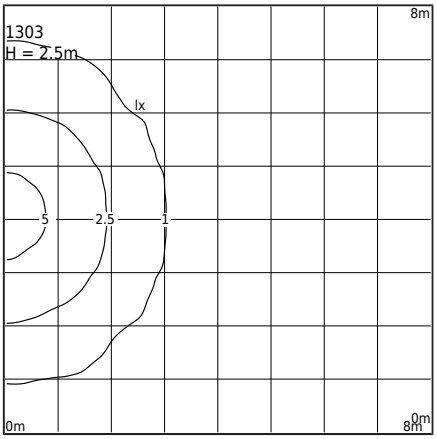

Type of luminaire

Type of luminaire	Wall light,
Photometric body	Double-sided light: directed up and down.
Characteristics of the luminaire	Luminaire with a wide range of applications for example for illumination of walls and facade surfaces or any other architectural concepts.

General information

Materials	Powder painted aluminum cast. Lens - transparent polycarbonate with structure, UV stabilized. Silicone gasket. EPDM cable gland.
Mounting method	Fixing of the luminaire: mounting plate with 2 adjust holes 5x10mm, spacing 45mm, directly 2 holes ø5mm, spacing 68 mm.
Terminal	Connection terminals: max 3x2,5mm², possibility to connect luminaire in loop max 3x1,5mm². A round wire in the isolation with a diameter of ø7...10,5mm.
Type of light source	Lamp E27 A55...A60 Replaceable light source by an end-user.
Luminaire weight net / gross	2,7kg / 3kg
Box dimensions [cm]	34,5cm x 15cm x 17cm
Luminaire dimensions [cm]	30,2cm x 12,1cm x 12,5cm

Technical data

Lamp E27	LED A55..60
Light source wattage	LED max 9W
Luminaire wattage	LED max 9W
ULOR	50%
Ambient operating temp. range	-20...+45°C

Possibility to order the luminaire with LED E27 Philips Master LEDbulb 806lm / 8,5W / 2700K (dimmable).

Files to download

Photometric LDT files	Photometric IES files
Manual	BIM Revit
BIM ArchiCAD	

Indexes

Index	Color	RAL
1303AL	ALUMINUM	9006
1303BL	BLACK	9005
1303GR	GRAPHITE	7016
1303WH	WHITE	9003

Other colors according to the "Colors Template" pattern book - available on request, subject to agreement with Norlys' Sales Department.

Norlys AS
P.B 1014 Hoff, 0218
Oslo
Hovfaret 4B, 0275
Oslo
Norway
+47 24 12 40 11
firmapost@norlys.no

TÜVRheinland CERTIFIED
Management System ISO 9001:2015 IATF 16949:2016
www.tuv.com ID 9108651873
PCC cert CERTIFICATE ISO 14001
RoHS 2011/65/UE

Please read the manual before installing. Due to the dynamic development of lighting technology, additional information is available upon request. LED module must be replaced by a qualified person in accordance with applicable regulations. Condensation, which can occur in luminaires, is a natural phenomenon and does not impair the quality of the luminaire.