

NORLYS MANDAL 1374


AC 220-240V 50-60Hz | IP 44 | IK 08 | GU10 LED

Mandal 1374XX0010
16.09.2026 v.10.11
www.norlys.no



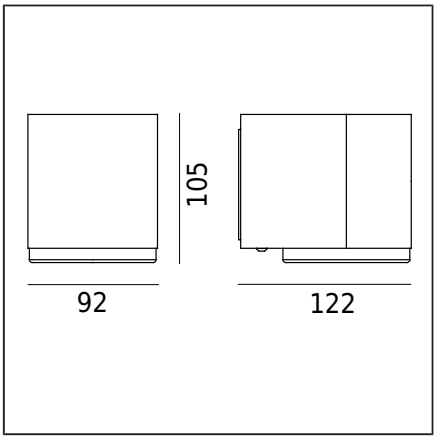

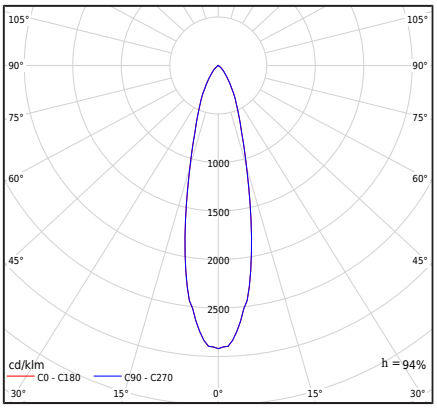

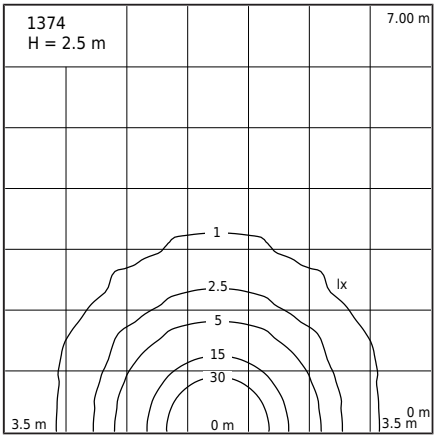

Type of luminaire

Type of luminaire	Wall light,
Photometric body	Single-sided light with 25D beam angle facing down
Characteristics of the luminaire	Wall-mounted luminaire with modern design. For lighting private areas and public spaces.

General information

Materials	Base - galvanized steel. Front - galvanized steel or powder coated galvanized steel. Lampshade - safety glass, transparent. Silicone gasket.
Mounting method	Fixing of the luminaire: 2 holes ø4,2mm, spacing 45mm.
Terminal	Connection terminals: max 3x2,5mm², possibility to connect luminaire in loop max 3x1,5mm². A round wire in the isolation with a diameter of ø7...10,5mm.
Type of light source	LED GU10 lamp Replaceable (LED only) light source by an end-user.
Luminaire weight net / gross	0,85kg / 1kg
Box dimensions [cm]	12,5cm x 13cm x 10cm
Luminaire dimensions [cm]	9,2cm x 12,2cm x 10,5cm

Technical data

LED Lamp GU10	LED PAR16
Light source wattage	LED max 4W
Luminaire wattage	LED max 4W
ULOR	0%
Ta Rated temperature	+25°C
Ambient operating temp. range	-20...+45°C
Possibility to order luminaire with LED GU10 lamp type Philips Master LED ExpertColor 256lm/3,9W/2700K/25D (dimmable).	
BUG rating	B0-U0-G0

Accessories sold separately

130XX0009	Corner bracket

Files to download

Photometric LDT files	Photometric IES files
Manual	BIM ArchiCAD

Indexes

Index	Color	RAL
1374BL	BLACK	9005
1374GA	HOT-DIP GALVANIZING	-

Other colors according to the "Colors Template" pattern book - available on request, subject to agreement with Norlys' Sales Department.

Norlys AS
P.B 1014 Hoff, 0218
Oslo
Hovfaret 4B, 0275
Oslo
Norway
+47 24 12 40 11
firmapost@norlys.no

TÜVRheinland CERTIFIED — Management System ISO 9001:2015 IATF 16949:2016 — www.tuv.com ID 9108651873

PCC Cert CERTIFICATE ISO 14001

RoHS 2011/65/UE

Please read the manual before installing. Due to the dynamic development of lighting technology, additional information is available upon request. LED module must be replaced by a qualified person in accordance with applicable regulations. Condensation, which can occur in luminaires, is a natural phenomenon and does not impair the quality of the luminaire.