

NORLYS ALTA 293


AC 220-240V 50-60Hz | IP 65 | IK 08 | E27

Alta 293XX0011
16.09.2026 v.11.9
www.norlys.no



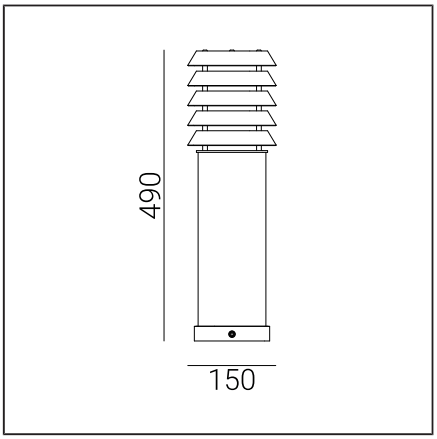

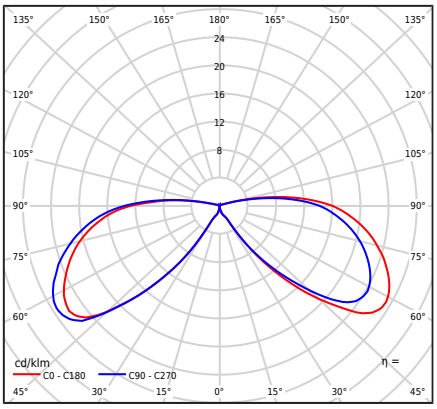

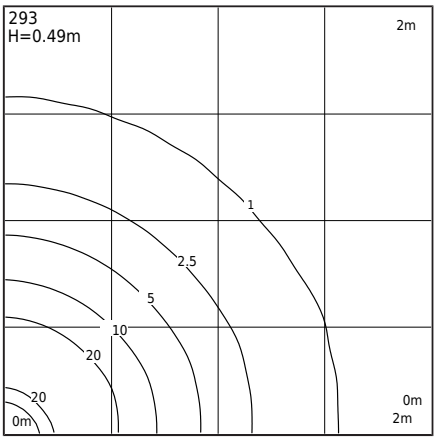

Type of luminaire

Type of luminaire	Post light fixture.
Photometric body	Top-shaded rotationally symmetrical light.
Characteristics of the luminaire	Bollard luminaire of stable and durable construction. For lighting private areas and public spaces.

General information

Materials	Hot-dip galvanized steel. Lens - plastic PMMA in milky color. Silicone gasket.
Mounting method	Fixing of the luminaire: 3 holes ø9mm with a diameter of ø65mm every 120°.
Terminal	Connection terminals: max 3x4mm², possibility to connect luminaire in loop max 3x2,5mm². A round wire in the isolation with a diameter of max ø12,5mm.
Type of light source	Lamp E27 A55...A60 Replaceable light source by an end-user.
Luminaire weight net / gross	5,28kg / 6,31kg
Box dimensions [cm]	21cm x 21,5cm x 57cm
Luminaire dimensions [cm]	15cm x 15cm x 49cm

Technical data

Lamp E27	LED A55..60
Light source wattage	LED max 9W
Luminaire wattage	LED max 9W
ULOR	11%
Ta Rated temperature	+25°C
Ambient operating temp. range	-20...+45°C
Possibility to order luminaire with LED E27 lamp Philips Master LEDbulb 806lm / 8,5W / 2700K (dimmable).	
BUG rating	B0-U1-G0

Accessories sold separately

3086GA0009	Mounting adapter
3080GA0009	Mounting adapter
205ZX0010	Concreting anchor
206GA0010	Ground anchor
206GA0S10	Adapter for concrete foundation

Spare parts

06291001	Lampshade - service kit
08288004	Gasket.

Files to download

Photometric LDT files	Photometric IES files
Manual	BIM ArchiCAD

Indexes

Index	Color	RAL
293BL	BLACK	9005
293GA	HOT-DIP GALVANIZING	-

Other colors according to the "Colors Template" pattern book - available on request, subject to agreement with Norlys' Sales Department.

Norlys AS
P.B 1014 Hoff, 0218
Oslo
Hovfaret 4B, 0275
Oslo
Norway
+47 24 12 40 11
firmapost@norlys.no

TÜVRheinland CERTIFIED
Management System ISO 9001:2015 IATF 16949:2016
www.tuv.com ID 9108651873

PCC cert CERTIFICATE ISO 14001

RoHS 2011/65/UE

Please read the manual before installing. Due to the dynamic development of lighting technology, additional information is available upon request. LED module must be replaced by a qualified person in accordance with applicable regulations. Condensation, which can occur in luminaires, is a natural phenomenon and does not impair the quality of the luminaire.