

NORLYS VISBY 5003


AC 220-240V 50-60Hz | IP 65 | LED

Visby 5003XX0309
06.11.2026 v.09.4
www.norlys.no



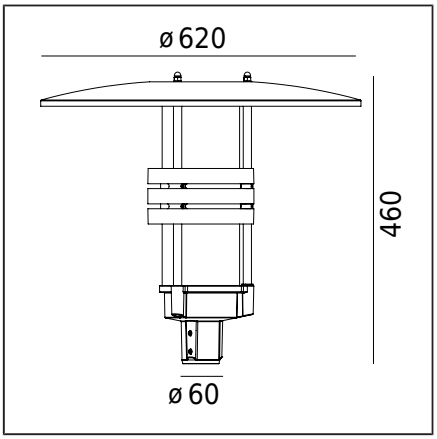

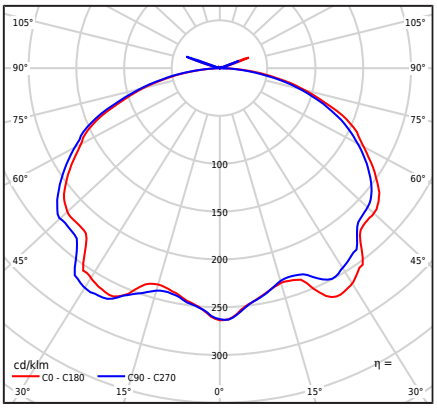

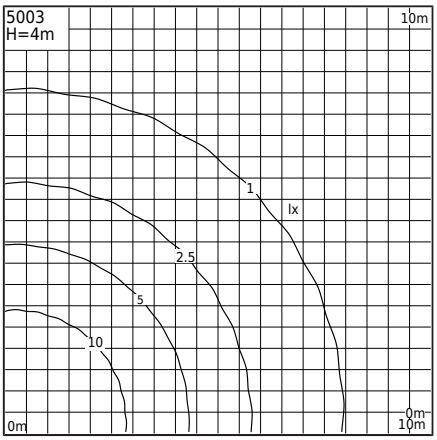

Type of luminaire

Type of luminaire	Pole luminaire.
Photometric body	Indirect light with rotationally symmetrical light distribution.
Characteristics of the luminaire	Surface-mounted luminaire designed to be installed on a lighting pole with a mounting post of Ø60mm.

General information

Materials	Powder painted aluminum cast. Lens - transparent plastic PMMA. Silicone gasket.
Mounting method	Fixing of the luminaire: fitting to Ø60mm pole.
Terminal	4.5m cable (H05VV-F 3G1 type), for connection inside the lighting pole (in the appropriately selected electrical installation box).
Type of light source	LED module AC integrated
Light control	Non-dimmable fixture
Luminaire weight net / gross	7,28kg / 8,92kg
Side area of luminaire	0,086m^2

Technical data

LED module	Philips Fortimo LED DLM ES 3000/840 G2
Light source wattage	27W
Luminaire wattage	26,5W
Lamp luminous flux	3150lm
Luminaire luminous flux	1553lm
Efficiency of the luminaire	58,6lm/W
ULOR	1,74%
Color temperature	4000K
Colour consistency (McAdam ellipse)	SDCM3
Colour rendering index CRI	80
Power Factor luminaire	> 0,9
Ta Rated temperature	+25°C
Optional version, deadline, and terms of execution to be agreed upon with the Sales Department of Norlys Sp. z o.o.	
Inrush current	2,63A/47,27µs
BUG rating	"B1-U2-G1"

Accessories sold separately

3070XX0009	Reduction
154XX0010	Mounting adapter
7660XX0009	Reduction

Spare parts

0950030200	Electrical service kit.

Files to download

Photometric LDT files	Photometric IES files
Manual	

Indexes

Index	Color	RAL
5003AL	ALUMINUM	9006
5003GR	GRAPHITE	7016

Other colors according to the "Colors Template" / RAL pattern book - available on request, subject to agreement with Norlys' Sales Department.

Norlys AS
P.B 1014 Hoff, 0218
Oslo
Hovfaret 4B, 0275
Oslo
Norway
+47 24 12 40 11
firmapost@norlys.no

TÜVRheinland CERTIFIED — Management System ISO 9001:2015 IATF 16949:2016 — www.tuv.com ID 9108651873

PCC cert CERTIFICATE ISO 14001

RoHS 2011/65/UE

Please read the manual before installing. Due to the dynamic development of lighting technology, additional information is available upon request. LED module must be replaced by a qualified person in accordance with applicable regulations. Condensation, which can occur in luminaires, is a natural phenomenon and does not impair the quality of the luminaire.