

# NORLYS ALTA 5021


AC 220-240V 50-60Hz | IP 65 | IK 08 | LED | DIM

Alta 5021XX0013
16.09.2026 v.13.21
www.norlys.no

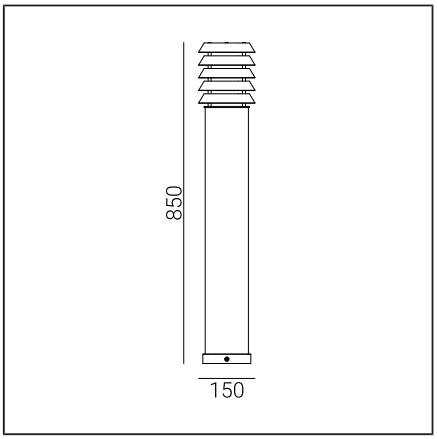

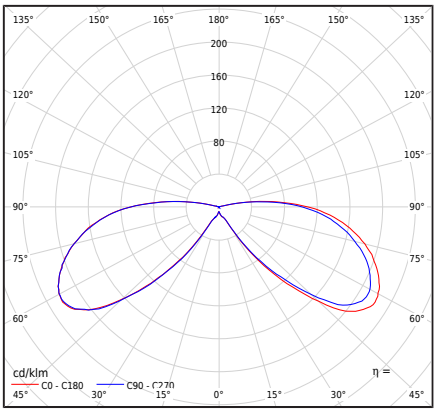


## Type of luminaire
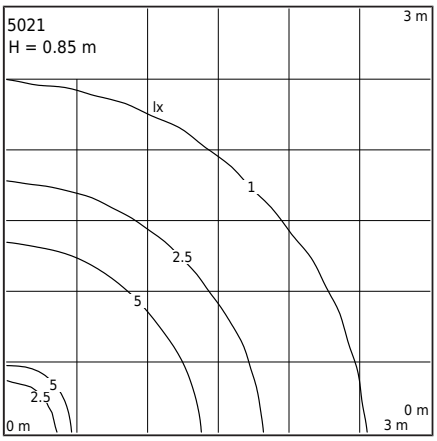
| | |
|---|---|
| Type of luminaire | Post light fixture. |
| Photometric body | Top-shaded rotationally symmetrical light. |
| Characteristics of the luminaire | Post lamp with a stable and durable design.<br>For lighting private areas and other architectural concepts. |

## General information

| | |
|---|---|
| Materials | Hot-dip galvanized steel. Hot-dip galvanized and powder-coated steel.<br>Lens - plastic PMMA in milky color. Silicone gasket. |
| Mounting method | Fixture attachment: 3 holes ø9mm, on a diameter of ø65mm at 120° intervals.<br>According to the attached installation instructions.<br>Other accessories need to be purchased separately. |
| Terminal | Terminal blocks: max 2x4mm²,<br>possibility to connect the fixture in a loop max 2x2.5mm².<br>Round cable with a maximum diameter of ø12.5mm. |
| Type of light source | LED module, electronic power supply<br>Replaceable (LED only) light source by a professional.<br>Replaceable control gear by a professional. |
| Light control | Phase-dimming (TRIAC) TRAILING EDGE (TE) - LEADING EDGE (LE) |
| Luminaire weight net / gross | 9,3kg / 10,7kg |
| Box dimensions [cm] | 20,5cm x 20,5cm x 91cm |

## Technical data

| | |
|---|---|
| LED module | Philips Fortimo SLM C 1203 L09 1619 G7 4K (Datasheet) |
| Driver | Yes |
| Driver durability | 50000h |
| External control | Dim. TRIAC (KGP) (User manual) |
| Light source wattage | 6,7W |
| Luminaire wattage | 8,5W |
| Lamp luminous flux | 1121lm |
| Luminaire luminous flux | 151lm |
| Efficiency of the luminaire | 17,8lm/W |
| ULOR | 10% |
| Color temperature | 4000K |
| Colour consistency (McAdam ellipse) | SDCM3 |
| Colour rendering index CRI | 80 |
| L70TM-21 [wg LM-80] | >50 000h |
| Power Factor luminaire | PF 0,90 |
| Ta Rated temperature | +25°C |
| Ambient operating temp. range | -20...+45°C |

This product contains light source of energy efficiency class D / EPREL

Optionally, the fixture is also available:
- in a safety version for KL I
- for LED color 2700K [1/1]
- for different luminous flux values
- in a version with a surge protection device (SPD)
- for different fixture colors (according to the RAL color palette)
- for different fixture heights

Terms of sale and additional information, to be agreed with the Sales Department of Norlys.

## Accessories sold separately

| | |
|---|---|
| 3086GA0009 | Mounting adapter |
| 3080GA0009 | Mounting adapter |
| 205ZX0010 | Concreting anchor |
| 206GA0010 | Ground anchor |
| 206GA0S10 | Adapter for concrete foundation |

## Spare parts

| | |
|---|---|
| ZS5021zx0013 | Service set. |

Norlys AS
P.B 1014 Hoff, 0218
Oslo
Hovfaret 4B, 0275
Oslo
Norway
+47 24 12 40 11
firmapost@norlys.no

TÜVRheinland CERTIFIED — Management System ISO 9001:2015 IATF 16949:2016 — www.tuv.com ID 9108651873

PCC Cert CERTIFICATE ISO 14001

RoHS 2011/65/UE

Before starting assembly, please familiarize yourself with the instructions included with the fixture. Assembly and service tasks should be performed by a person with appropriate authorizations and qualifications, in compliance with applicable regulations. Due to the dynamic development of lighting technology, we provide additional information at the customer's request. Condensation, which may occur in fixtures, is a natural phenomenon and does not affect the quality of the fixture.

# NORLYS ALTA 5021



## Files to download

| | |
|---|---|
| Photometric LDT files | Photometric IES files |
| BIM ArchiCAD | |

## Indexes

| Index | Color | RAL |
|---|---|---|
| 5021BL | BLACK | 9005 |
| 5021GA | HOT-DIP GALVANIZING | - |

Other colors according to the "Colors Template" pattern book - available on request, subject to agreement with Norlys' Sales Department.

Norlys AS
P.B 1014 Hoff, 0218
Oslo
Hovfaret 4B, 0275
Oslo
Norway
+47 24 12 40 11
firmapost@norlys.no

Management System ISO 9001:2015 IATF 16949:2016
www.tuv.com ID 9108651873
CERTIFICATE ISO 14001
RoHS 2011/65/UE

Before starting assembly, please familiarize yourself with the instructions included with the fixture. Assembly and service tasks should be performed by a person with appropriate authorizations and qualifications, in compliance with applicable regulations. Due to the dynamic development of lighting technology, we provide additional information at the customer's request. Condensation, which may occur in fixtures, is a natural phenomenon and does not affect the quality of the fixture.