



NORLYS ASKER POLE 5126

Asker pole
5126XX0009
16.09.2026 v.09.15
www.norlys.no

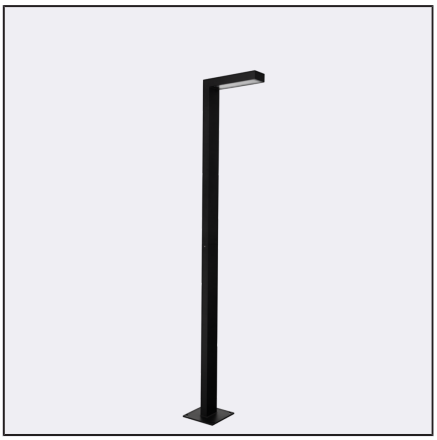

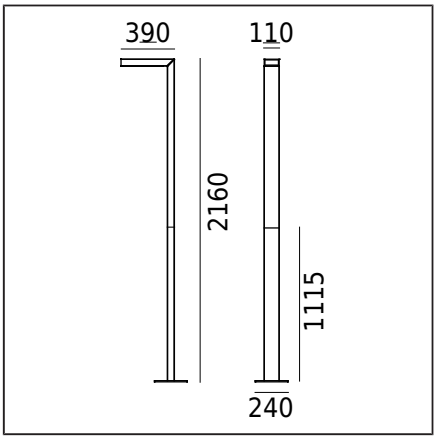

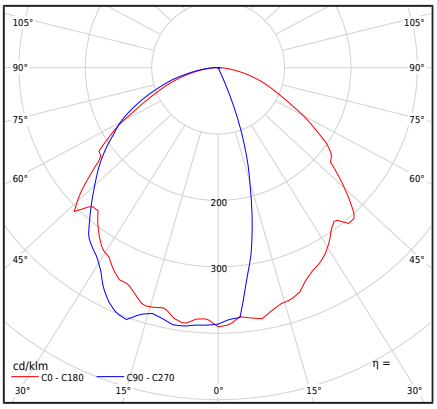

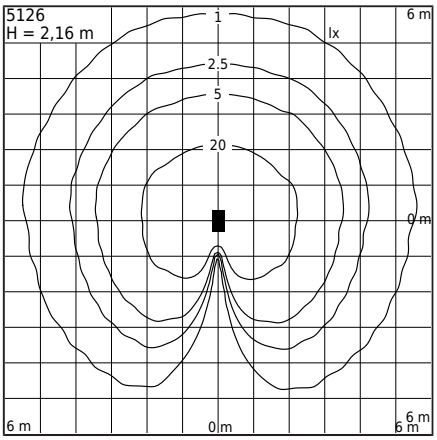

Type of luminaire

Type of luminaire	Pole luminaire (light construction).
Photometric body	Downward-directed light.
Characteristics of the luminaire	Luminaire for lighting private areas, and other architectural concepts. The tightness of the lighting and connection chamber is IP65.

General information

Materials	Extruded aluminum profile, powder coated. Lens - transparent polycarbonate with structure, UV stabilized. Silicone gasket.
Mounting method	Fixing of the luminaire: 4 holes on a diameter ø12mm, spacing 200x200mm. Other accessories need to be purchased separately
Terminal	Connection terminals: max 3x2,5mm², possibility to connect luminaire in loop max 3x2,5mm². Round insulated cable with a diameter of max ø12,5mm
Type of light source	LED module AC integrated Replaceable (LED only) light source by a professional.
Light control	Phase-dimming (TRIAC) TRAILING EDGE (TE) - LEADING EDGE (LE)
Luminaire weight net / gross	10,54kg / 12,11kg
Box dimensions [cm]	25cm x 115cm x 56cm
Side area of luminaire	0,232m²

Technical data

2 LED modules	Lumens LNM/280X30/9W/830/230V
External control	Phase dimmer Lumens LED AC (User manual)
Light source wattage	18W
Luminaire wattage	18W
Lamp luminous flux	1778lm
Luminaire luminous flux	1100lm
Efficiency of the luminaire	61,1lm/W
ULOR	0%
Color temperature	4000K
Colour consistency (McAdam ellipse)	SDCM3
Colour rendering index CRI	80
LED photobiological threat	RG0 or RG1
Power Factor luminaire	PF > 0,99
THD factor	< 20%
Ta Rated temperature	+25°C
Ambient operating temp. range	-20...+45°C
Inrush current	108,8mA/500µs
BUG rating	B1-U1-G0

Accessories sold separately

117GA0009	Ground anchor
116ZX0009	Concreting anchor

Spare parts

ZS5126zx0009	Service set.

Files to download

Photometric LDT files	Photometric IES files
Manual	BIM Revit
BIM ArchiCAD	

Norlys AS
P.B 1014 Hoff, 0218
Oslo
Hovfaret 4B, 0275
Oslo
Norway
+47 24 12 40 11
firmapost@norlys.no

Management System ISO 9001:2015 IATF 16949:2016 TÜVRheinland CERTIFIED www.tuv.com ID 9108651873

PCC Cert CERTIFICATE ISO 14001

RoHS 2011/65/UE

Please read the manual before installing it. Due to the dynamic development of lighting technology, additional information is available upon request. LED modules must be replaced by a qualified person in accordance with applicable regulations. Condensation, which can occur in luminaires, is a natural phenomenon and does not impair the quality of the luminaire

ASKER POLE 5126

Indexes

Index	Color	RAL
5126AL	ALUMINUM	9006
5126BL	BLACK	9005
5126GR	GRAPHITE	7016

Other colors according to the "Colors Template" pattern book - available on request, subject to agreement with Norlys' Sales Department.

Norlys AS
P.B 1014 Hoff, 0218
Oslo
Hovfaret 4B, 0275
Oslo
Norway
+47 24 12 40 11
firmapost@norlys.no

Please read the manual before installing it. Due to the dynamic development of lighting technology, additional information is available upon request. LED modules must be replaced by a qualified person in accordance with applicable regulations. Condensation, which can occur in luminaires, is a natural phenomenon and does not impair the quality of the luminaire