

NORLYS HAMMERFEST 5133


AC 220-240V 50-60Hz | IP 65 | LED | D4i

Hammerfest
5133XX0010
16.09.2026 v.10.4
www.norlys.no



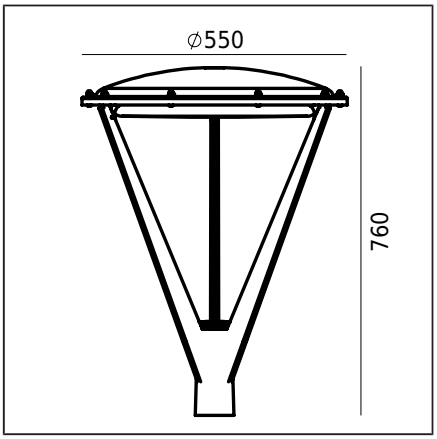

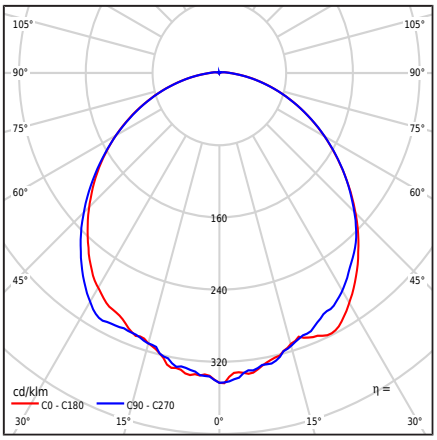

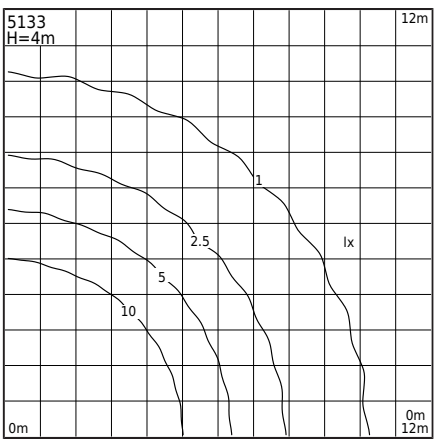

Type of luminaire

Type of luminaire	Pole luminaire.
Photometric body	Diffused light, covered from the top.
Characteristics of the luminaire	Surface-mounted luminaire designed to be installed on a lighting pole with a mounting post of Ø60mm.

General information

Materials	Powder painted aluminum cast. Lens - satin PMMA plastic. Silicone gasket.
Type of light source	LED module, electronic power supply, Zhaga book18 connector Replaceable (LED only) light source by a professional. Replaceable control gear by a professional.
Light control	Light control in the D4i system. Power supply programmed for max permitted current. Programming of the remaining parameters after contact with the Norlys Sales Department.

Technical data

LED module	Cree DK190707 V3 JB2835 3K (Datasheet)
Driver	Yes
Driver durability	100000h
External control	D4i (User manual)
Light source wattage	26,9W
Luminaire wattage	32W
Lamp luminous flux	5200lm
Luminaire luminous flux	4408lm
Efficiency of the luminaire	137,8lm/W
ULOR	2%
Color temperature	3000K
Colour consistency (McAdam ellipse)	SDCM3
Colour rendering index CRI	80
L80TM-21 [wg LM-80]	>102 000h
L90 TM-21 [wg LM-80]	>52 600h
Power Factor luminaire	PF 0,98
THD factor	10%
Overvoltage	6 / 8kV
Ta Rated temperature	+25°C
Ambient operating temp. range	-20...+45°C
This product contains light source of energy efficiency class C / EPREL	
Inrush current	21A/300µs

Maximum number of luminaires of this type per MCB:

B 10A: 13, B 16A: 21, C 10A: 21, C 16A: 35

Files to download

Photometric LDT files	Photometric IES files
Manual	BIM Revit
BIM ArchiCAD	

Indexes

Index	Color	RAL
5133AL	ALUMINUM	9006
5133GR	GRAPHITE	7016

Other colors according to the "Colors Template" pattern book - available on request, subject to agreement with Norlys' Sales Department.

Norlys AS
P.B 1014 Hoff, 0218
Oslo
Hovfaret 4B, 0275
Oslo
Norway
+47 24 12 40 11
firmapost@norlys.no

TÜVRheinland CERTIFIED — Management System ISO 9001:2015 IATF 16949:2016 — www.tuv.com ID 9108651873

PCC Cert CERTIFICATE ISO 14001

RoHS 2011/65/UE

Before starting installation, please read the manual attached to the fixture. Installation and maintenance work is carried out by a person with appropriate authorizations and qualifications, in accordance with applicable regulations. Due to the dynamic development of lighting technology, additional information is provided upon customer request. Condensation that may occur in the fixtures is a natural phenomenon and does not affect the quality of the fixture.