

NORLYS BERLIN 610


IP 54 | IK 10 | E27 | AC 220-240V 50-60Hz

Berlin 610XX0011
16.09.2026 v.11.8
www.norlys.no



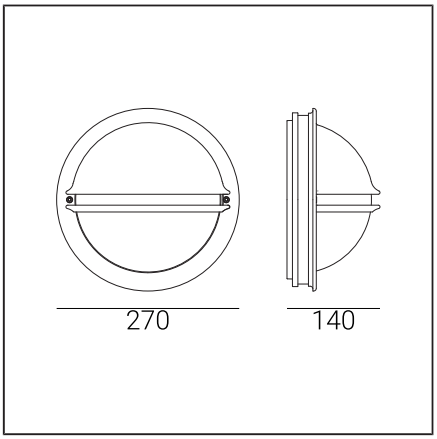

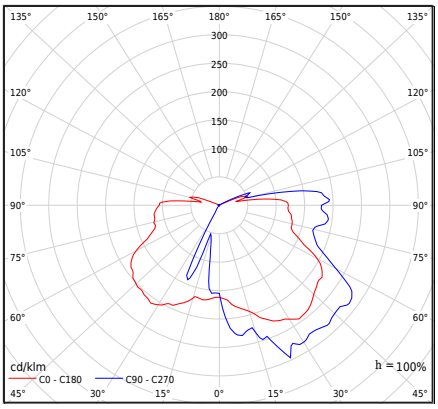

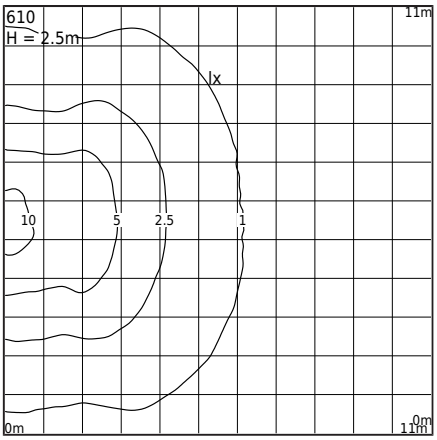

Type of luminaire

Type of luminaire	Wall light,
Photometric body	Uncovered light, partly covered from the top.
Characteristics of the luminaire	Classic design plafon type luminaire.

General information

Materials	Powder painted aluminum cast. Lens - clear polycarbonate, UV stabilized. Silicone gasket. EPDM cable gland.
Mounting method	Fixing of the luminaire: 2 holes ø4,2mm, spacing 155x40mm.
Terminal	Connection terminals: max 3x2,5mm², possibility to connect luminaire in loop max 3x1,5mm². A round wire in the isolation with a diameter of ø7...10,5mm.
Type of light source	Lamp E27 A55...A60 Replaceable light source by an end-user.
Luminaire weight net / gross	1,69kg / 2kg
Box dimensions [cm]	27,5cm x 27,5cm x 15cm
Luminaire dimensions [cm]	27cm x 27cm x 14cm

Technical data

Lamp E27	LED A55..60
Light source wattage	LED max 9W
Luminaire wattage	LED max 9W
Luminaire luminous flux	468lm
Efficiency of the luminaire	52lm/W
ULOR	15%
Ta Rated temperature	+25°C
Ambient operating temp. range	-20...+45°C
Possibility to order luminaire with LED E27 lamp Philips Master LEDbulb 806lm / 8,5W / 2700K (dimmable).	
BUG rating	B0-U2-G1

Spare parts

06620005	Lampshade - service kit
08550004	Gasket.

Files to download

Photometric LDT files	Photometric IES files
Manual	

Indexes

Index	Color	RAL
610BL	BLACK	9005
610WH	WHITE	9003

Other colors according to the "Colors Template" pattern book - available on request, subject to agreement with Norlys' Sales Department.

Norlys AS
P.B 1014 Hoff, 0218
Oslo
Hovfaret 4B, 0275
Oslo
Norway
+47 24 12 40 11
firmapost@norlys.no

TÜVRheinland CERTIFIED
Management System ISO 9001:2015 IATF 16949:2016
www.tuv.com ID 9108651873

PCC Cert CERTIFICATE ISO 14001

RoHS 2011/65/UE

Please read the manual before installing. Due to the dynamic development of lighting technology, additional information is available upon request. LED module must be replaced by a qualified person in accordance with applicable regulations. Condensation, which can occur in luminaires, is a natural phenomenon and does not impair the quality of the luminaire.