

NORLYS BERLIN 615


AC 220-240V 50-60Hz | IP 54 | IK 10 | E27 LED | DIM

Berlin 615XX0012
16.09.2026 v.12.16
www.norlys.no



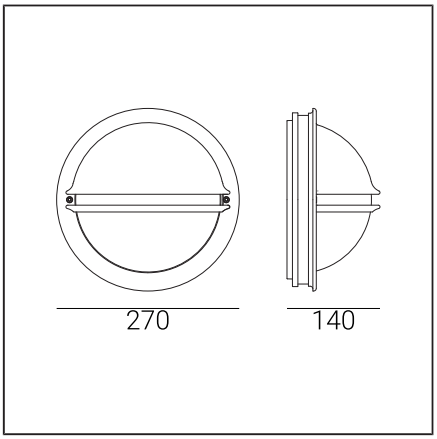

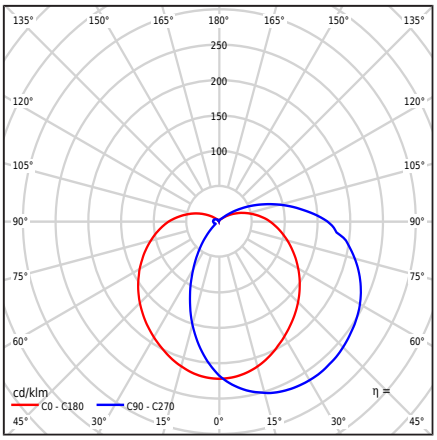

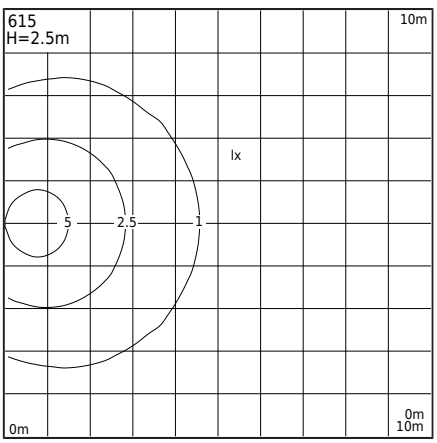

Type of luminaire

Type of luminaire	Wall light,
Photometric body	Diffuse downward-directed hemispherical light
Characteristics of the luminaire	Plafond type luminaire with modern design.

General information

Materials	Powder painted aluminum cast. Lens - milky polycarbonate, UV stabilized. Silicone gasket. EPDM cable gland.
Mounting method	Fixing of the luminaire: 2 holes ø5,3mm, spacing 170x45mm.
Terminal	Connection terminals: max 3x2,5mm², possibility to connect luminaire in loop max 3x1,5mm². A round wire in the isolation with a diameter of ø7...10,5mm.
Type of light source	LED Lamp E27 A55...A60 Replaceable (LED only) light source by an end-user.
Light control	Phase-dimming (TRIAC) TRAILING EDGE (TE) - LEADING EDGE (LE)
Luminaire weight net / gross	1,75kg / 2,06kg
Box dimensions [cm]	27,5cm x 27,5cm x 15cm
Luminaire dimensions [cm]	27cm x 27cm x 14cm

Technical data

External control	Phase dimming LED GU10 E27 (User manual)
Light source wattage	LED max 9W
Luminaire wattage	8,3W
Luminaire luminous flux	240lm
ULOR	15%
Colour consistency (McAdam ellipse)	SDCM6
Colour rendering index CRI	80
Ta Rated temperature	+25°C
Ambient operating temp. range	-20...+45°C
This product contains light source of energy efficiency class	F
BUG rating	B0-U2-G0

Spare parts

06620003	Lampshade - service kit
08550005	Gasket.

Files to download

Photometric LDT files	Photometric IES files
Manual	

Indexes

Index	Color	RAL
615BL	BLACK	9005
615WH	WHITE	9003

Other colors according to the "Colors Template" pattern book - available on request, subject to agreement with Norlys' Sales Department.

Norlys AS
P.B 1014 Hoff, 0218
Oslo
Hovfaret 4B, 0275
Oslo
Norway
+47 24 12 40 11
firmapost@norlys.no

TÜVRheinland CERTIFIED — Management System ISO 9001:2015 IATF 16949:2016 — www.tuv.com ID 9108651873

PCC Cert CERTIFICATE ISO 14001

RoHS 2011/65/UE

Please read the manual before installing. Due to the dynamic development of lighting technology, additional information is available upon request. LED module must be replaced by a qualified person in accordance with applicable regulations. Condensation, which can occur in luminaires, is a natural phenomenon and does not impair the quality of the luminaire.