

NORLYS BASEL 660


AC 220-240V 50-60Hz | IP 54 | IK 07 | E27

Basel 660XX0009
16.09.2026 v.09.10
www.norlys.no



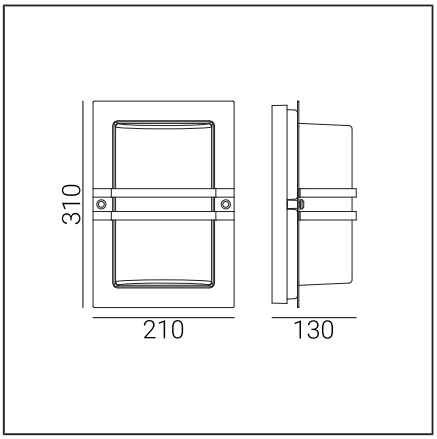

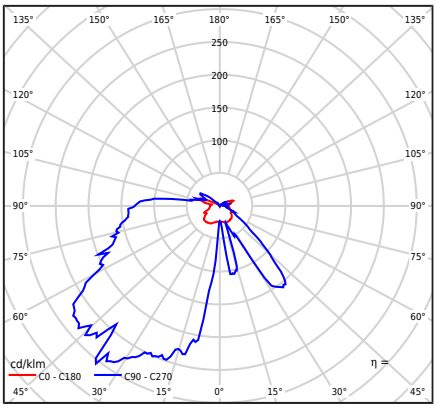

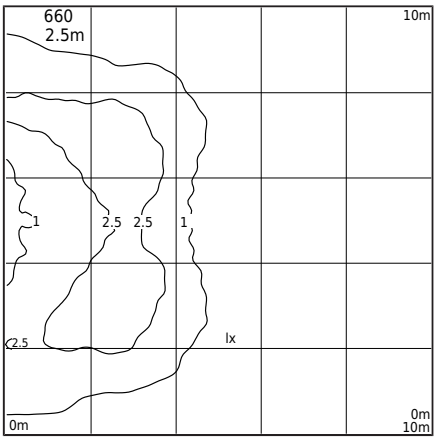

Type of luminaire

Type of luminaire	Wall light,
Photometric body	Light discovered
Characteristics of the luminaire	Modern design plafon type luminaire.

General information

Materials	Base - powder painted aluminum cast. Front - stainless steel , hot dip galvanized steel, powder coated steel. Lens - safety glass, transparent. Silicone gasket.
Mounting method	Fixing of the luminaire: 2 holes ø4,5mm, spacing 138x50mm.
Terminal	Connection terminals: max 3x2,5mm², possibility to connect luminaire in loop max 3x1,5mm². A round wire in the isolation with a diameter of ø7...10,5mm.
Type of light source	Lamp E27 A55...A60 Replaceable light source by an end-user.
Luminaire weight net / gross	2,94kg / 3,64kg
Box dimensions [cm]	27,5cm x 23cm x 33,5cm
Luminaire dimensions [cm]	21cm x 13cm x 31cm

Technical data

Lamp E27	LED A55..60
Light source wattage	LED max 9W
Luminaire wattage	LED max 9W
ULOR	13%
Ta Rated temperature	+25°C
Ambient operating temp. range	-20...+45°C
Possibility to order the fixture along with a Philips Master LEDbulb E27 806lm/5.9W/2700K (dimmable) lamp.	
BUG rating	B0-U2-G1

Spare parts

06660004	Lampshade - service kit
08652662	Gasket.

Files to download

Photometric LDT files	Photometric IES files
3D models and drawings	Manual

Indexes

Index	Color	RAL
660BL	BLACK	9005
660GA	HOT-DIP GALVANIZING	-
660ST	STAINLESS STEEL	-

Other colors according to the "Colors Template" pattern book - available on request, subject to agreement with Norlys' Sales Department.

Norlys AS
P.B 1014 Hoff, 0218
Oslo
Hovfaret 4B, 0275
Oslo
Norway
+47 24 12 40 11
firmapost@norlys.no

TÜVRheinland CERTIFIED — Management System ISO 9001:2015 IATF 16949:2016 — www.tuv.com ID 9108651873

PCC cert CERTIFICATE ISO 14001

RoHS 2011/65/UE

Please read the manual before installing. Due to the dynamic development of lighting technology, additional information is available upon request. LED module must be replaced by a qualified person in accordance with applicable regulations. Condensation, which can occur in luminaires, is a natural phenomenon and does not impair the quality of the luminaire.