

NORLYS FIRENZE 805


AC 220-240V 50-60Hz | IP 54 | E27

Firenze 805XX0011
16.09.2026 v.11.9
www.norlys.no



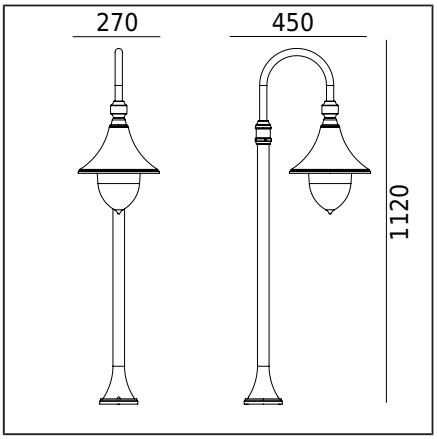

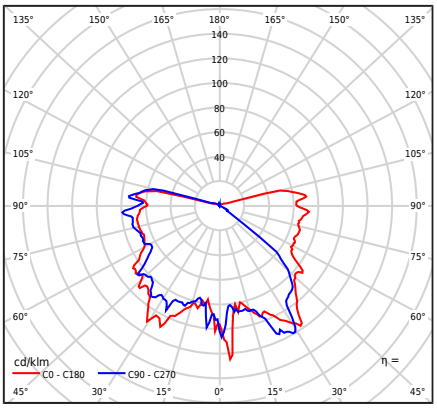

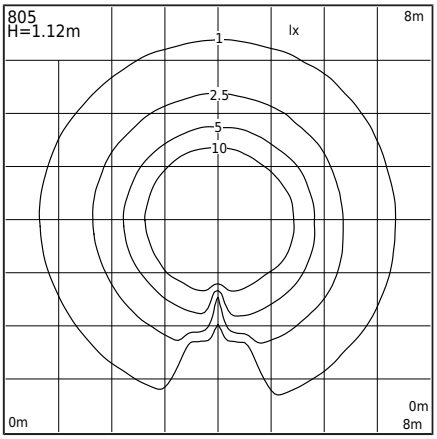

Type of luminaire

Type of luminaire	Post light fixture.
Photometric body	Uncovered light, partly covered from the top.
Characteristics of the luminaire	Classic design luminaire. For lighting gardens, private areas and public spaces. Other accessories need to be purchased separately.

General information

Materials	Powder painted aluminum cast. Lens - clear polycarbonate, UV stabilized. EPDM cable gland.
Mounting method	Fixing the luminaire: 2 holes ø5mm, spacing 90mm.
Terminal	Connection terminals: max 2x2,5mm², possibility to connect luminaire in loop max 2x1,5mm². A round wire in the isolation with a diameter of max ø7...10,5mm.
Type of light source	Lamp E27 A55...A60 Replaceable light source by an end-user.
Luminaire weight net / gross	2,65kg / 3,55kg
Box dimensions [cm]	24,5cm x 23cm x 82cm

Technical data

Lamp E27	LED A55...60
Light source wattage	LED max 9W
Luminaire wattage	LED max 9W
ULOR	18%
Ta Rated temperature	+25°C
Ambient operating temp. range	-20...+45°C
Possibility to order a fixture with a Philips Master LEDbulb 806lm/8.5W/2700K (dimmable) LED E27 lamp.	
BUG rating	B0-U3-G1

Accessories sold separately

307ZX0009	Concreting anchor

Spare parts

06370797	Lampshade - service kit

Files to download

Photometric LDT files	Photometric IES files
Manual	

Indexes

Index	Color	RAL
805BL	BLACK	9005
805WH	WHITE	9003

Other colors according to the "Colors Template" pattern book - available on request, subject to agreement with Norlys' Sales Department.

Norlys AS
P.B 1014 Hoff, 0218
Oslo
Hovfaret 4B, 0275
Oslo
Norway
+47 24 12 40 11
firmapost@norlys.no

TÜVRheinland CERTIFIED — Management System ISO 9001:2015 IATF 16949:2016 — www.tuv.com ID 9108651873

PCC cert CERTIFICATE ISO 14001

RoHS 2011/65/UE

Please read the manual before installing. Due to the dynamic development of lighting technology, additional information is available upon request. LED module must be replaced by a qualified person in accordance with applicable regulations. Condensation, which can occur in luminaires, is a natural phenomenon and does not impair the quality of the luminaire.