

NORLYS FIRENZE 830


AC 220-240V 50-60Hz | IP 54 | E27

Firenze 830XX0309
16.09.2026 v.09.6
www.norlys.no



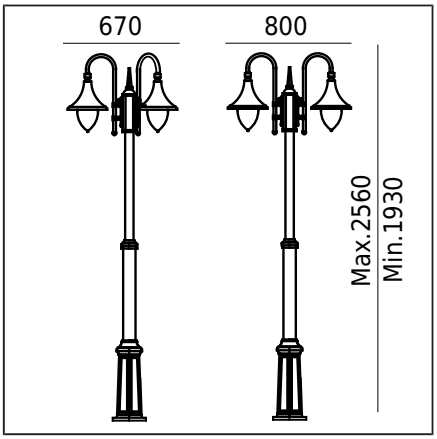

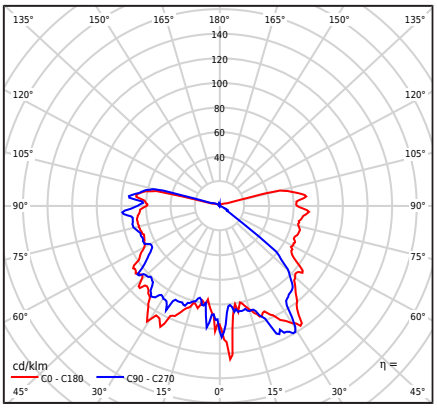

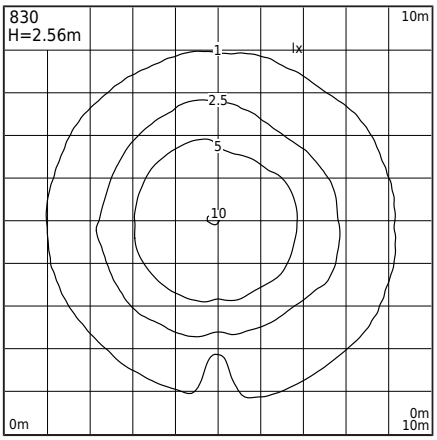

Type of luminaire

Type of luminaire	Pole luminaire
Photometric body	Light discovered
Characteristics of the luminaire	Classic design luminaire, mounted on a telescopic lighting pole. Adjustable height 1930..2560mm. For lighting gardens, terraces and other architectural concepts.

General information

Materials	Powder painted aluminum cast. Lens - clear polycarbonate, UV stabilized. Silicone gasket.
Mounting method	Fixing of the luminaire: 3 holes ø10,5mm, on a daimeter ø240mm every 120°. Set contains: Art. 8012 - luminaire, Art. 3040 - reduction, Art. 3010 - lightning pole. Other accessories need to be purchased separately.
Terminal	Connection terminal: max. 4x2,5mm², possibility to connect luminaire in loop max 4x2,5mm². A round wire in the isolation with a diameter of max ø6...12,5mm.
Type of light source	Lamp E27 A55...A60 Replaceable light source by an end-user.
Luminaire weight net / gross	12,31kg / 16,38kg

Technical data

Lamp E27	LED A55..60
Light source wattage	LED max 3x 9W
Luminaire wattage	LED max 3x 9W
ULOR	18%
Ta Rated temperature	+25°C
Ambient operating temp. range	-20...+45°C
Possibility to order the luminaire with LED E27 Philips Master LEDbulb 806lm / 8,5W / 2700K (dimmable).	
BUG rating	B0-U3-G1

Accessories sold separately

7668ZX0009	Concrete foundation
30101XX0011	Telescopic pole
3010XX0011	Telescopic pole
305ZX0009	Concreting anchor
306ZX0009	Ground anchor
108GA0309	Adapter for concrete foundation
6010GA0010	Mounting adapter

Spare parts

06370797	Lampshade - service kit

Files to download

Photometric LDT files	Photometric IES files
Manual	

Indexes

Index	Color	RAL
830BL	BLACK	9005
830WH	WHITE	9003

Other colors according to the "Colors Template" pattern book - available on request, subject to agreement with Norlys' Sales Department.

Norlys AS
P.B 1014 Hoff, 0218
Oslo
Hovfaret 4B, 0275
Oslo
Norway
+47 24 12 40 11
firmapost@norlys.no

TÜVRheinland CERTIFIED
Management System ISO 9001:2015 IATF 16949:2016
www.tuv.com ID 9108651873
PCC Cert CERTIFICATE ISO 14001
RoHS 2011/65/UE

Please read the manual before installing. Due to the dynamic development of lighting technology, additional information is available upon request. LED module must be replaced by a qualified person in accordance with applicable regulations. Condensation, which can occur in luminaires, is a natural phenomenon and does not impair the quality of the luminaire.