

NORLYS ASKER DC24V DC1311


DC24V | Klasa III | IP 65 | IK 10 | LED

Asker DC24V
1311XX0A14
16.09.2026 v.14.14
www.norlys.no



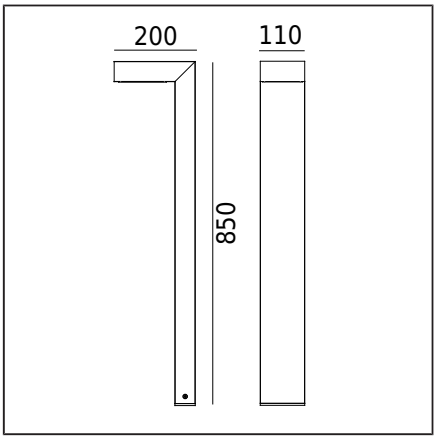

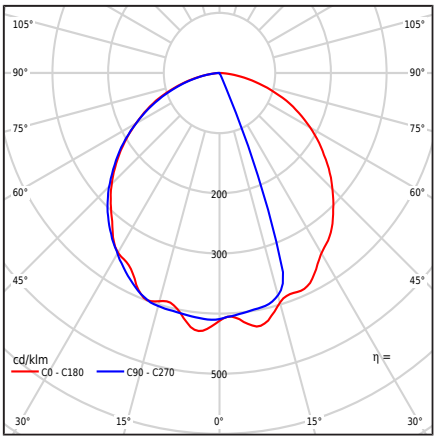

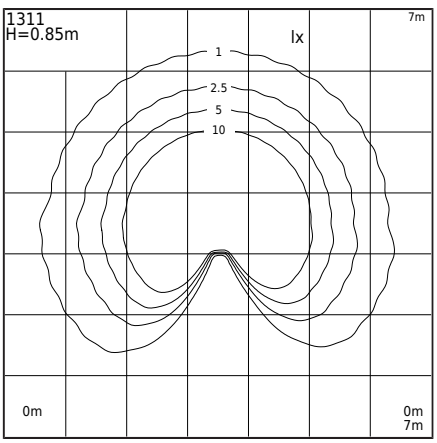

Type of luminaire

Type of luminaire	Post light fixture.
Photometric body	Downward-directed light.
Characteristics of the luminaire	A fixture with contemporary design. For lighting private areas and other architectural concepts. The fixture requires an external power supply. LED module suitable for dimming.

General information

Materials	Powder painted aluminum cast. Lens - transparent polycarbonate with structure, UV stabilized. Silicone gasket. EPDM cable gland.
Mounting method	Fixture mounting: 4 holes ø8mm, spacing 18x50mm. In accordance with the included installation instructions. Other accessories must be purchased separately.
Terminal	Connection terminals: max 2x4mm², possibility of fixture looping max 2x4mm². Round cable diameter: ø5...12mm
Type of light source	LED module DC24V, requires an external power source [voltage-stabilized power supply] Replaceable (LED only) light source by a professional.
Light control	Choosing the appropriate power supply and executing the lighting installation should only be carried out by a person with the necessary qualifications and in accordance with current regulations.
Luminaire weight net / gross	4,01kg / 4,36kg
Box dimensions [cm]	88cm x 23cm x 13cm
Luminaire dimensions [cm]	85cm x 20cm x 11cm

Technical data

2 LED modules	Cree DK251110 J2835B DC24V 3,6W 3000K (Datasheet)
External control	According to the design.
Light source wattage	7,2W
Luminaire wattage	8,5W
Lamp luminous flux	1064lm
Luminaire luminous flux	533lm
Luminous intensity of the luminaire	231cd
Efficiency of the luminaire	62,7lm/W
ULOR	0%
Color temperature	3000K
Colour consistency (McAdam ellipse)	SDCM3
Colour rendering index CRI	80
L80TM-21 [wg LM-80]	>102 000h
L90 TM-21 [wg LM-80]	>52 600h
LED photobiological threat	RG0
Ta Rated temperature	+25°C
Ambient operating temp. range	-30...+50°C

This product contains light sources of energy efficiency class D / EPREL

BUG rating	B0-U1-G0

Accessories sold separately

1907ZX0009	Concreting anchor
3081XX0009	Mounting adapter
3090GA0009	Mounting adapter
1909GA0010	Adapter for concrete foundation
1908GA0009	Ground anchor

Spare parts

99ZX0009	Maintenance kit for lighting fixtures
ZN06131100	Lampshade - service kit
ZN1311zx0A14	Service set.

Norlys AS
P.B 1014 Hoff, 0218
Oslo
Hovfaret 4B, 0275
Oslo
Norway
+47 24 12 40 11
firmapost@norlys.no

TÜVRheinland CERTIFIED — Management System ISO 9001:2015 IATF 16949:2016 — www.tuv.com ID 9108651873

PCC cert CERTIFICATE ISO 14001

RoHS 2011/65/UE

Before starting the installation, please read the instructions attached to the fixture. Installation and servicing should be carried out by a person with appropriate authorizations and qualifications, in accordance with applicable regulations. Due to the dynamic development of lighting technology, additional information is provided at the client's request. Condensation that may occur in fixtures is a natural phenomenon and does not affect the quality of the fixture.

ASKER DC24V DC1311



Files to download

Photometric LDT files	Photometric IES files
Manual	BIM Revit
BIM ArchiCAD	

Indexes

Index	Color	RAL
DC1311AL	ALUMINUM	9006
DC1311BL	BLACK	9005
DC1311CG	CEMENT GREY	7033
DC1311CB	COPPER BROWN	8004
DC1311CS	CORTEN STEEL	approx. 8011
DC1311GR	GRAPHITE	7016
DC1311GB	GREY BEIGE	7006

Other colors according to the "Colors Template" pattern book - available on request, subject to agreement with Norlys' Sales Department.

Norlys AS
P.B 1014 Hoff, 0218
Oslo
Hovfaret 4B, 0275
Oslo
Norway
+47 24 12 40 11
firmapost@norlys.no

Management System ISO 9001:2015 IATF 16949:2016
TÜVRheinland CERTIFIED
www.tuv.com ID 9108651873
PCC Cert CERTIFICATE ISO 14001
RoHS 2011/65/UE

Before starting the installation, please read the instructions attached to the fixture. Installation and servicing should be carried out by a person with appropriate authorizations and qualifications, in accordance with applicable regulations. Due to the dynamic development of lighting technology, additional information is provided at the client's request. Condensation that may occur in fixtures is a natural phenomenon and does not affect the quality of the fixture.